# GOODWE



# **User Manual**

**Rechargeable Li-ion Battery System** 

Lynx Home FH Series US



### Copyright@GoodWe Technologies Co.,Ltd. 2025. All rights reserved.

No part of this manual can be reproduced or transmitted to the public platform in any form or by any means without the prior written authorization of GoodWe.

#### **Trademarks**

GOODWE

and other GOODWE trademarks are trademarks of GoodWe Technologies Co.,Ltd. All other trademarks or registered trademarks mentioned in this manual are owned by GoodWe Technologies Co.,Ltd.

#### NOTICE

The information in this user manual is subject to change due to product updates or other reasons. This quide cannot replace the product labels or the safety precautions in the user manual unless otherwise specified. All descriptions here are for guidance only.

# Content

01 About This Manual	01
1.1 Applicable Model	01
1.2 Target Audience	01
1.3 Symbol Definition	01
2 IMPORTANT SAFETY INSTRUCT	IONS02
2.1 General Safety	02
2.2 Battery Safety	02
2.3 Emergency Measures	04
03 Product Introduction	05
3.1 Product Overview	05
3.2 Application Scenarios	06
3.3 Appearance	07
3.4 Dimensions	09
04 Check and Storage	10
4.1 Check Before Receiving	10
4.2 Deliverables	10
4.3 Storage	11
5 System Installation	12
5.1 Installation Requirements	12
5.2 Installing the Battery System	14
5.2.1 Moving the Equipment	14
5.2.2 Installing the Battery System	14
6 Electrical Connection	22
6.1 Safety Precaution	22
6.2 Electrical Connection	23
6.2.1 Installing the Wiring Conduit	26
6.2.2 Connecting the Communication Co	able27
6.2.3 Connecting the Power Cable	28
6.2.4 Connecting the Communication Co	able29
6.2.5 Installing the top cover of the PCU	31
07 System Operation	32
7.1 Check Before Power ON	
	32
7.2 Power ON the Battery System	

7.4 Indicator Status	35
7.4.1 Normal Status	35
7.4.2 Alarming Status	36
7.4.3 Faulty Status	36
08 Maintenance	38
8.1 Power OFF the Battery System	38
8.2 Routine Maintenance	38
8.3 Recycling and Disposal	39
09 Parameters	40

### 01 About This Manual

This manual describes the product information, installation, electrical connection, commissioning, troubleshooting and maintenance. Read through this manual before installing and operating the product. All the installers and users have to be familiar with the product features, functions, and safety precautions.

This manual is subject to update without notice. For more product details and latest documents, visit <a href="https://us.goodwe.com/">https://us.goodwe.com/</a>.

### 1.1 Applicable Model

This manual applies to the listed models below:

- LX F9.6-30
- LX F12.8-30
- LX F16.0-30
- LX F19.2-30

### 1.2 Target Audience

This manual applies to trained and knowledgeable technical professionals. The technical personnel has to be familiar with the product, local standards, and electric systems.

### 1.3 Symbol Definition

Different levels of warning messages in this manual are defined as follows:

### 🚹 DANGER(DANGER)

Indicates a high-level hazard that, if not avoided, will result in death or serious injury.

### WARNING(AVERTISSEMENT)

Indicates a medium-level hazard that, if not avoided, could result in death or serious injury.

### **!** CAUTION(MISE EN GARDE)

Indicates a low-level hazard that, if not avoided, could result in minor or moderate injury.

#### NOTICE(AVIS)

Highlight and supplement the texts. Or some skills and methods to solve product-related problems to save time.

### 2 IMPORTANT SAFETY INSTRUCTIONS

SAVE THESE INSTRUCTIONS

Please strictly follow these safety instructions in the user manual during the operation.

#### NOTICE(AVIS)

The products are designed and tested strictly to comply with related safety rules. Read and follow all the safety instructions and cautions before any operations. Improper operation might cause personal injury or property damage as the products are electrical equipment.

### 2.1 General Safety

#### NOTICE(AVIS)

- The information in this user manual is subject to change due to product updates or other reasons. This guide cannot replace the product labels or the safety precautions in the user manual unless otherwise specified. All descriptions here are for guidance only.
- Before installations, read through the user manual to learn about the product and the precautions.
- All operations should be performed by trained and knowledgeable technicians who are familiar with local standards and safety regulations.
- Use insulating tools and wear personal protective equipment (PPE) when operating the
  equipment to ensure personal safety. Wear anti-static gloves, cloths, and wrist strips when
  touching electronic devices to protect the equipment from damage.
- Strictly follow the installation, operation, and configuration instructions in this manual. The
  manufacturer shall not be liable for equipment damage or personal injury if you do not
  follow the instructions. For more warrant information, please visit: <a href="https://en.goodwe.com/warranty">https://en.goodwe.com/warranty</a>.

# 2.2 Battery Safety

### DANGER(DANGER)

- The battery system exists high voltage during the equipment running. Please keep Power Off before any operations to avoid danger. Strictly follow all safety precautions outlined in this manual and safety labels on the equipment during the operation.
- The inverter used with the battery shall be approved by the battery manufacturer. The approved list of battery and the matched inverter can be obtained through the official website.
- Do not disassemble, modify, or replace any part of the battery or the power control unit without official authorization from the manufacturer. Otherwise, it will cause electrical shock or damages to the equipment, which shall not be borne by the manufacturer.
- Do not hit, pull, drag, squeeze or step on the equipment or put the battery into fire. Otherwise, the battery may explode.
- Do not place the battery in a high temperature environment. Make sure that there is no direct sunlight and no heat source near the battery. When the ambient temperature exceeds 60°C, it will cause fire.
- Do not use the battery or the power control unit if it is defective, broken, or damaged.
   Damaged battery may leak electrolyte.
- To protect the battery pack and its components from damage during transportation, please
  ensure that the transportation personnel are professionally trained. All operations during the
  transportation have to be recorded. The equipment shall be kept in balance, thus avoiding
  falling down.

### **⚠** DANGER(DANGER)

- The battery equipment is heavy. Please equip the corresponding personnel according to its weight, so that the equipment does not exceed the weight range of the human body can carry, and cause personnel injury.
- Contact After Sale Service immediately if the battery is not able to be started. Otherwise, the battery might be damaged permanently.
- Do not move the battery system if it is connected with external battery modules. Contact after-sales service if the battery shall be replaced or added.

### ( CAUTION(MISE EN GARDE)

- Protect the battery system from damage during transportation and storage.
- The transportation must be carried out by trained professionals. All operations during the process have to be recorded.
- Keep the equipment stable to avoid dumping, which can result in equipment damage and personal injuries.
- Place the cables at least 30mm away from the heating components or heat sources, otherwise the insulation layer of the cables may be aging or broken due to high temperature.
- Tie the cables of the same type together, and place cables of different types at least 30mm apart. Do not place the cables entangled or crossed.

#### Label Description

	Potential risks exist. Wear proper personnel protective equipment before any operations.	<b>(%)</b>	Install the equipment away from fire sources.
A	HIGH VOLTAGE HAZARD High voltage exists during the equipment's running. Ensure the equipment is power off before any operations.		Keep the equipment away from children.
	Operate the equipment properly to avoid explosion danger.		It is forbidden to dismantle the equipment personally.
	The equipment contains corrosive electrolytes. In case of a leak in the equipment, avoid contact the leaked liquid or gas.		Do not short-circuit the positive and negative pole of the equipment. Otherwise it may cause damage to the cables.
	Batteries contain flammable materials, beware of fire.	$\bigoplus$	Grounding point.
	Read through the user manual before any operations.	SGS 800923	SGS marking for United States and Canada

## 2.3 Emergency Measures

### **Battery Electrolyte Leakage**

If the battery module leaks electrolyte, avoid contact with the leaking liquid or gas. The electrolyte is corrosive. It will cause skin irritation or chemical burn to the operator. Anyone contact the leaked substance accidentally has to do as following:

- Breath in the leaked substance: Evacuate from the polluted area, and seek immediate medical assistance.
- Eye contact: Rinse your eyes for at least 15 minutes with clean water and seek immediate medical assistance.
- Skin contact: Thoroughly wash the touch area with soap and clean water, and seek immediate
  medical assistance.
- Ingestion: Induce vomiting, and seek immediate medical assistance.

#### Fire

- The battery may explode when the ambient temperature exceeds 150°C. Poisonous and hazard gas may be released if the battery is on fire.
- In the event of a fire, please make sure that the carbon dioxide extinguisher or Novac1230 or FM-200 is nearby.
- The fire cannot be put out by water or ABC dry powder extinguisher. Firefighters are required to wear full protective clothing and self-contained breathing apparatus.

### 03 Product Introduction


### 3.1 Product Overview

#### Intended usage


The battery system, which consists of a power control unit (PCU for short) and battery modules, can store and release the electric energy according to the requirements of the solar energy storage system. The input and output ports of the energy storage system are high voltage direct current ports.

### Usable energy description


The battery system supports capacity expansion. A maximum of 6 battery modules can be used to extend the usable energy of the battery system.

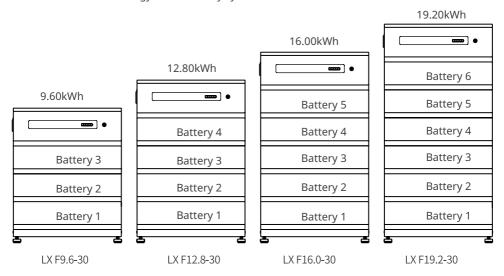

A max of eight battery systems can be parallel connected in one energy storage system. Ensure that the usable energy of each battery system is the same.

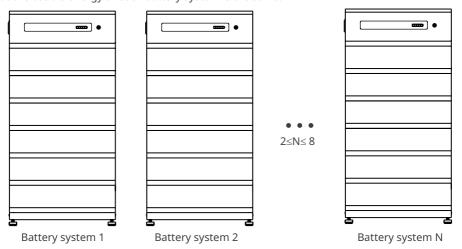

# 3.2 Application Scenarios

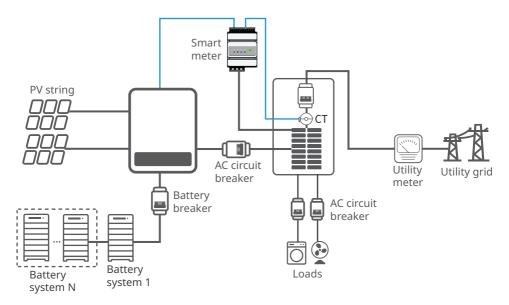

### **Approved inverter list**

Scan the QR code below or visit the official website to get the Approved Inverter List matched with the Battery System.




GoodWe Inverter



**GE** Inverter

### 3.3 Appearance

### **Battery system appearance**




### **NOTICE(AVIS)**

- Ensure that the PCU is installed above the battery modules. Do not install any battery modules above the PCU.
- This manual will show you the installation and electrical connection of 6 battery modules.

No.	Parts	
1	PCU	
2, 3, 4, 5, 6, 7	Battery	
8	Base	

### **Battery appearance**




No.	Parts	
1	Spacing hole	
2	Positioning pin	
3	Rectangular connector	

#### **Base appearance**


### **NOTICE(AVIS)**


The appearance of the battery base is slightly different, and the installation method is the same. This manual uses one of the base as an example.




No.	Parts	
1	Spacing hole	
2	Positioning pin	
3	Rectangular connector	
4	Adjustable feet installing hole	

# Power control unit appearance












No.	Parts	
1	Ventilation valve	
2	Cable hole	
3	Air switch	
4	SOC indicator	
5	Multi-function button	
6	Battery serial connection interface	

### 3.4 Dimensions

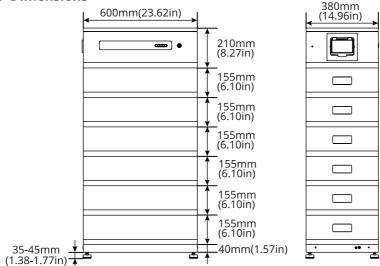



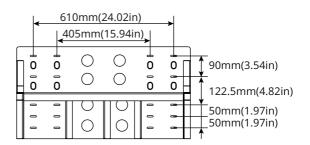

# 04 Check and Storage


# 4.1 Check Before Receiving

Check the following items before receiving the product.


- 1. Check the outer packing box for damage, such as holes, cracks, deformation, and other signs of equipment damage. Do not unpack the package and contact the supplier as soon as possible if any damage is found.
- 2. Check the product model. If the product model is not what you requested, do not unpack the product and contact the supplier.
- 3. Check the deliverables for correct model, complete contents, and intact appearance. Contact the supplier as soon as possible if any damage is found.

### 4.2 Deliverables


#### Power control unit

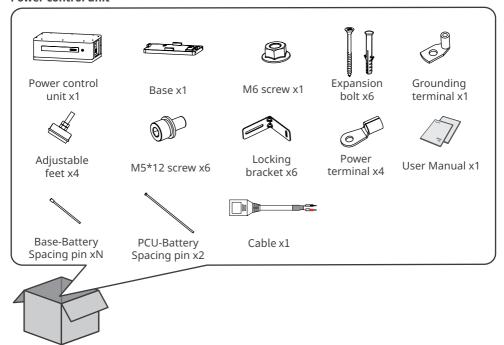

#### **Battery module**

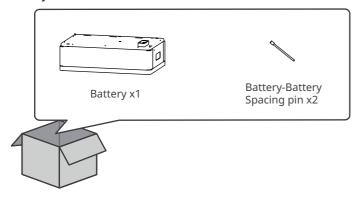

### Wall-mount rack (Optional)

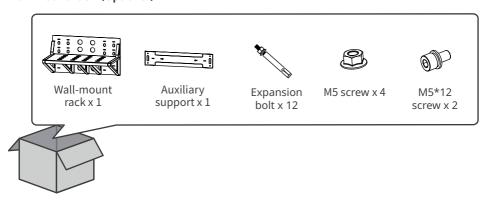

# 4.3 Storage

If the equipment is not to be installed or used immediately, please ensure that the storage environment meets the following requirements:


- 1. Do not unpack the outer packing box or throw the desiccant away.
- 2. Complete the equipment installation in three days after unpacking it. Pack and store the equipment using the original packing box if it is not installed.
- 3. Stack the equipment complying with the labels and requirements on the packing box.
- 4. The equipment must be stacked with caution to prevent them from falling.
- 5. Keep the equipment away from flammable, explosive, and corrosive matters.
- 6. Place the equipment in a cool place where away from direct sunlight.
- 7. Store the equipment in a clean place. Make sure the temperature and humidity are appropriate and no condensation.
- 8. Storage SOC: 25%~50% SOC. Circle the charge-discharge every 6 months.
- 9. Recommended storage temperature: 0°C~35°C (less than one year), -20°C~0°C or 35°C~45°C(less than one month).
- 10.Recommended storage humidity: 0%~95%RH (no condensation). Do not install the battery if there is any moisture or condensation.


# 5 System Installation

# **5.1 Installation Requirements**

### **Installation Environment Requirements**

- 1. Do not install the equipment in a place near flammable, explosive, or corrosive materials.
- 2. Do not install the equipment in a place that is easy to touch, especially within children's reach. High temperature exists when the equipment is working. Do not touch the surface to avoid burning.
- 3. Avoid thewater pipes and cables buried in the wall when drilling holes.
- 4. Install the equipment in a sheltered place to avoid direct sunlight, rain, and snow. Build a sunshade if it is needed.
- 5. Install the equipment in a well-ventilated place to ensure good dissipation. Also, the installation space should be large enough for operations.
- 6. The equipment with a high ingress protection rating can be installed indoors or outdoors. The temperature and humidity at the installation site should be within the appropriate range.
- 7. Install the equipment at a height that is convenient for operation and maintenance, electrical connections, and checking indicators and labels.
- 8. The altitude to install the equipment shall be lower than the maximum working altitude 3000m (9842ft).

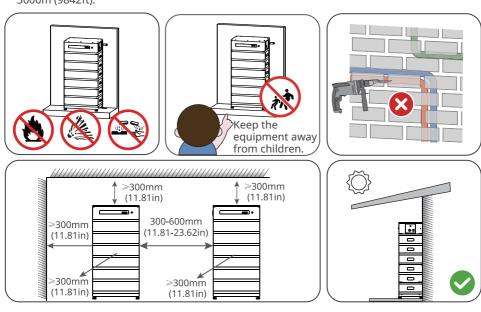

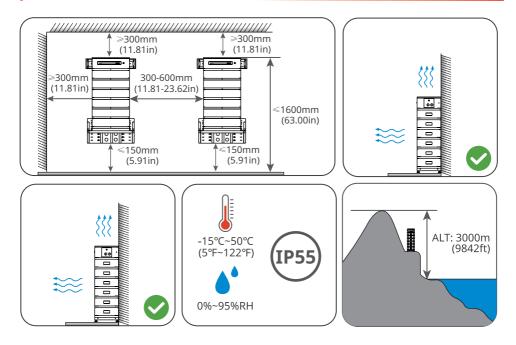


### **Mounting Support Requirements**

- The mounting support shall be nonflammable and fireproof.
- Install the equipment on a surface that is solid enough to bear the product weight.
- Put the battery system near the wall and install the locking brackets to prevent the battery from falling down.

#### **Installation Angle Requirements**

Install the equipment vertically, no tilt or upside down.

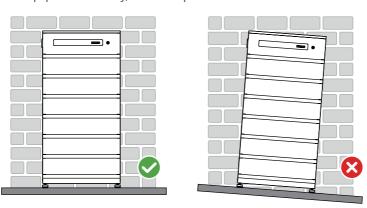

### **Installation Tool Requirements**

The following tools are recommended when installing the equipment. Use other auxiliary tools on site if necessary.



# 5.2 Installing the Battery System

### 5.2.1 Moving the Equipment


# CAUTION(MISE EN GARDE)


- Operations such as transportation, turnover, installation and so on must meet the requirements of the laws and regulations of the country or region where it is located.
- Move the equipment to the site before installation. Follow the instructions below to avoid personal injury or equipment damage.
  - 1. Consider the weight of the equipment before moving it. Assign enough personnel to move the equipment to avoid personal injury.
  - 2. Wear safety gloves to avoid personal injury.
  - 3. Keep balance to avoid falling down when moving the equipment.

### 5.2.2 Installing the Battery System

#### NOTICE(AVIS)

- Ensure that the ground is flat and no inclination.
- Ensure that the base stands on the floor vertically.
- Ensurethat the base clings to the wallwith its arrow directs at the wall
- Align the holes of the upper and the lower battery modules when placing the upper battery module.
- Put the locking bracket of the PCU cling to the wall, and ensure that the bottom of the PCU is vertically and closely put on the battery.
- Cover the equipment with a cardboard to prevent foreign matters when drilling holes.
- Beware of the batteries and PCU falling down.
- Do not install the base and the locking bracket on one side.








- Keep the fastening screws after opening the top cover of PCU for later usage.
- Use the PCU-Battery Spacing pin to fix the last battery and PCU. Do not install the Battery-Battery Spacing pin.
- If you need to open the top cover of PCU in rain or snow, please take protective measures to prevent rain or snow from entering the maintenance chamber. If it is not able to be guaranteed, do not open the top cover.

# Floor Mounting


Disassemble the protective cover of the blind-mate connector.




- **Step 1:** Install the adjustable feet to the base.
- **Step 2:** Install the locking bracket to the base.
- **Step 3:** Place the base cling to the wall and mark the drilling positions. Then remove the base.
- **Step 4:** Drill holes with the hammer drill.
- Step 5: Check the battery base and ensure that the narrow on the base points to the wall.
- **Step 6:** Fasten the expansion bolts, ensuring the base is firmly installed.
- **Step 7:** Install the battery to the base.
- **Step 8:** Install the batteries from the bottom up as the instruction of Step 7.
- Step 9: Install the locking bracket of the PCU.
- **Step 10:** Put the PCU above the installed battery module securely. Mark the drilling hole with a marker, then remove the PCU.

ST5.5\*70

- **Step 11:** Drill holes with the hammer drill.
- **Step 12:** Fasten the expansion bolts, ensuring the PCU is firmly installed.
- Step 13: Open the top cover of the PCU.
- **Step 14:** Install the positioning pin between the PCU and the battery.

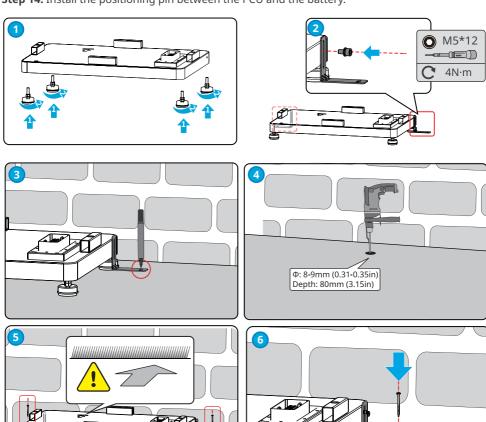

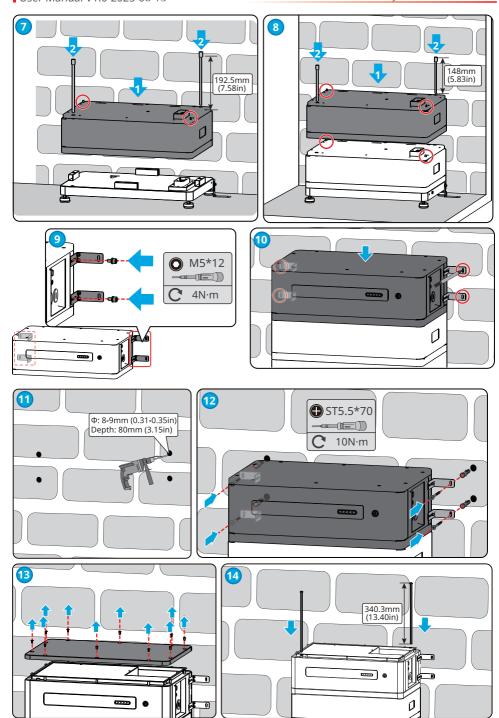


# **Wall Mounting**


Disassemble the protective cover of the blind-mate connector.





- **Step 1:** Place the rack against the wall, mark the drilling position with a marker, and remove the base.
- **Step 2:** Drill holes with the hammer drill.
- **Step 3:** Fix the rack with expansion screws.
- Step 4: Check the battery base and ensure that the narrow on the base points to the wall.
- **Step 5:** Install the locking bracket to the base.
- **Step 6:** Align the installation holes of the locking bracket and the rack.
- **Step 7:** Fix the base and rack.
- **Step 8:** Install the remaining batteries and PCU based on the actual needs.
- **Step 9:** Install the locking bracket of the PCU.
- **Step 10:** Put the PCU above the installed battery module securely. Mark the drilling hole with a marker, then remove the PCU.
- **Step 11:** Align the auxiliary bracket with the hole position on the PCU, mark the drilling position with a marker, and remove the auxiliary support.
- Step 12: Drill holes with the hammer drill.
- **Step 13:** Secure the auxiliary support with expansion screws.
- **Step 14:** Tighten the nuts to ensure that the PCU is securely installed.
- Step 15: Open the top cover of the PCU.
- **Step 16:** Install the positioning pin between the PCU and the battery.

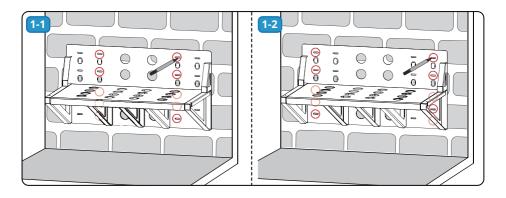



# 05 System Installation 📈







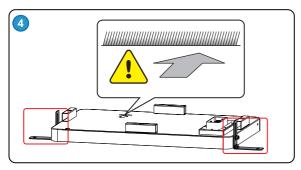










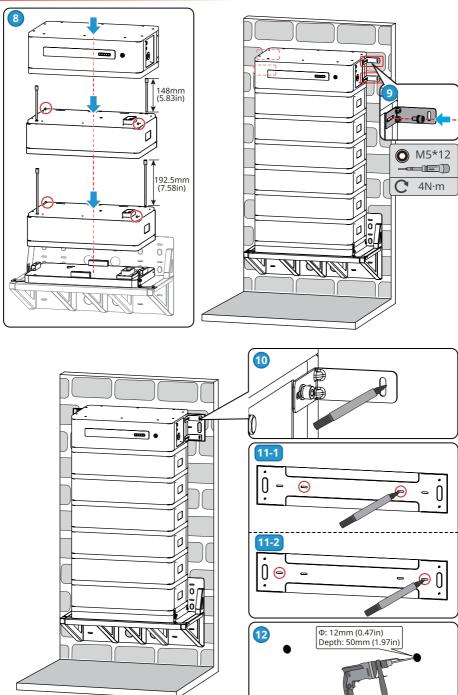

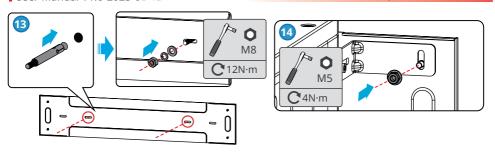





# 6 Electrical Connection

# **6.1 Safety Precaution**

### DANGER(DANGER)

### INSTRUCTIONS PERTAINING TO A RISK OF FIRE OR ELECTRIC SHOCK

- Perform electrical connections, including operations, cables, and component specifications in compliance with local laws and regulations ANSI/NFPA 70.
- The battery system exists high voltage during the equipment running. Please keep Power
  Off before any operations to avoid danger. Strictly follow all safety precautions outlined in
  this manual and safety labels on the equipment during the operation.
- All operations, cables and parts specification during the electrical connection shall be in compliance with local laws and regulations.
- Tie the same type cables together, and place them separately from cables of different types. Do not place the cables entangled or crossed.
- When crimping the terminals, ensure that the conductor part of the cable is in full contact with
  the terminals. Do not crimp the cable jacket with the terminal. Otherwise the charger may
  not operate, or its terminal block getting damaged due to heating and other phenomenon
  because of unreliable connection after operation.

#### INSTRUCTIONS CONCERNANT LES RISQUES D'INCENDIE OU D'ÉLECTROCUTION

- Effectuez les connexions électriques, y compris les opérations, les câbles et les spécifications des composants, conformément aux lois et réglementations locales ANSI/NFPA 70.
- Le système de batterie présente une haute tension pendant le fonctionnement de l'équipement. Veuillez couper l'alimentation avant toute intervention pour éviter tout danger. Suivez strictement toutes les précautions de sécurité décrites dans ce manuel ainsi que les étiquettes de sécurité sur l'équipement pendant l'opération.
- Toutes les opérations, les câbles et les spécifications des pièces lors de la connexion électrique doivent être conformes aux lois et réglementations locales.
- Attachez les câbles de même type ensemble et placez-les séparément des câbles de types différents. Ne laissez pas les câbles s'entremêler ou se croiser.
- Lors du sertissage des bornes, assurez-vous que la partie conductrice du câble est en contact complet avec les bornes. Ne serrez pas la gaine du câble avec la borne. Sinon, le chargeur pourrait ne pas fonctionner, ou son bornier pourrait être endommagé en raison d'un échauffement ou d'autres phénomènes dus à une connexion peu fiable après l'opération.

# WARNING(AVERTISSEMENT)

#### **GROUNDING INSTRUCTIONS**

This product must be connected to a grounded, metal, permanent wiring system, or an equipment-grounding conductor must be run with the circuit conductors and connected to the equipment grounding terminal or lead on the product.

### INSTRUCTIONS DE MISE À LA TERRE

Ce produit doit être connecté à un système de câblage permanent métallique et mis à la terre, ou un conducteur de mise à la terre doit être installé avec les conducteurs du circuit et connecté à la borne ou au fil de terre de l'équipement.

#### NOTICE(AVIS)


- Wear personal protective equipment like safety shoes, safety gloves, and insulating gloves during electrical connections.
- All electrical connections should be performed by qualified professionals.
- Cable colors in this document are for reference only. The cable specifications shall meet local laws and regulations.
- Portez des équipements de protection individuelle (EPI) tels que des chaussures de sécurité, des gants de protection et des gants isolants lors des connexions électriques.
- Toutes les connexions électriques doivent être réalisées par des professionnels qualifiés.
- Les couleurs des câbles mentionnées dans ce document sont données à titre indicatif uniquement. Les spécifications des câbles doivent être conformes aux lois et réglementations locales.

### 6.2 Electrical Connection


### **NOTICE(AVIS)**


- A max of eight battery systems can be parallel connected in one energy storage system.
   Ensure that the usable energy of each battery system is the same.
- · The PCU is installed with a terminal resistor by default.
- When a single battery system is applied, do not remove the terminal resistor.
- When using a multi battery system, please follow the steps below to install the terminal resistors:
  - 1. Remove the terminal resistor from COM2 of battery system 1 and install it in COM3.
  - 2. Remove the terminal resistors of battery system 2 to battery system N-1 and store them properly, then connect parallel communication cables.
  - 3. Do not remove the terminal resistor of battery system N.
- Un maximum de huit systèmes de batterie peut être connecté en parallèle dans un seul système de stockage d'énergie. Assurez-vous que l'énergie utilisable de chaque système de batterie est identique.
- Le PCU est équipé d'une résistance terminale par défaut.
- Pour un système de batterie unique : Ne retirez pas la résistance terminale.
- Pour un système multi-batteries : Suivez les étapes ci-dessous pour installer les résistances terminales :
  - Retirez la résistance terminale du COM2 du système de batterie 1 et installez-la dans COM3.
  - 2. Retirez les résistances terminales des systèmes de batterie 2 à N-1 et stockez-les correctement, puis connectez les câbles de communication parallèle.
  - 3. Ne retirez pas la résistance terminale du système de batterie N.

# Single battery system

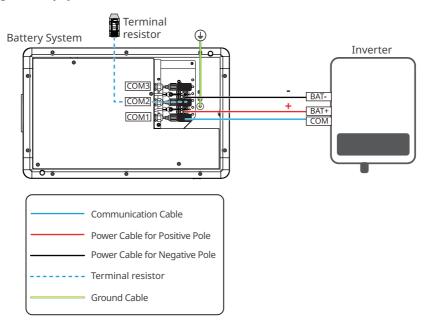

### **Parallized battery systems**

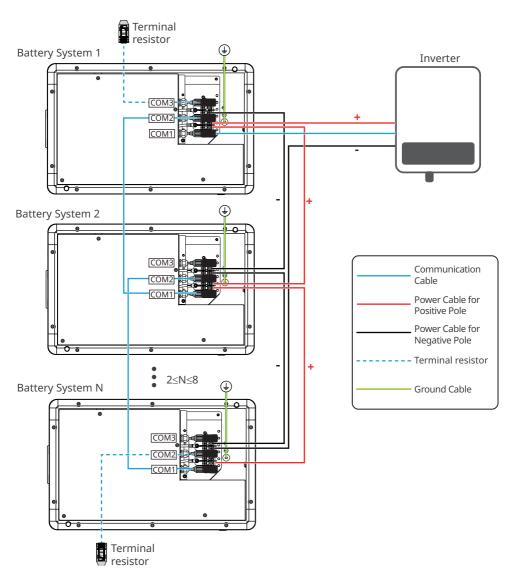

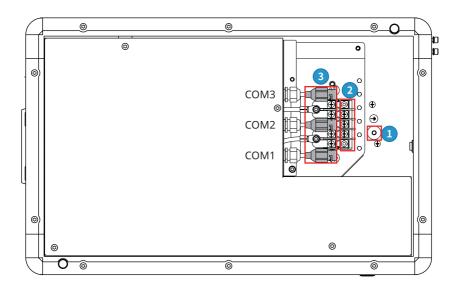


No.	Terminal/Port	Silkscreen	Recommended Cable Specifications
1	Grounding point	<b>(</b>	Connecting the PE cable  • The recommended specification: copper, temperature105°C (221°F), cross-sectional area 10AWG.
		<b>⊕</b>	Connecting the Power cable
2	DC Terminal (BAT)	$\ominus$	<ul> <li>The recommended specification: copper, temperature105°C (221°F), cross-sectional area 6AWG.</li> </ul>
		COM1	To realize the communication between the
3	Communication terminal	COM2	battery and the inverter, as well as among the
		COM3	batteries.


# 6.2.1 Installing the Wiring Conduit

### ! WARNING(AVERTISSEMENT)

- Conduit shall be prepared by Users with specification matched with the waterproof end cap.
- It is recommended to use 1 inch cable gland for routing. The diameter for the routing hole on the PCU is 34mm (1.34 in).
- When installing the conduit, make sure the installation is in place, and the hole between the conduit and the equipment interface is sealed. Otherwise the protection level of the equipment may be affected, which may cause damage to the equipment.

#### Diameter for the PCU routing hole







### 6.2.2 Connecting the Communication Cable

### NOTICE(AVIS)

- Connect the PE cable first before installing the equipment. Disconnect the PE cable before dismantling the equipment.
- Prepare the PE cable by Users. The cable should meet standards for outdoor use.
- The drawing force of the cable after crimping should be at least 400N.
- **Step 1:** Strip the insulation layer and insert the bared conductor into the terminal.
- Step 2: Crimp the PE cable.
- **Step 3:** Install the heat shrink tube.
- Step 4: Connect the PE cable.







### 6.2.3 Connecting the Power Cable

### ! WARNING(AVERTISSEMENT)

- Connect the DC cables with the delivered terminals. The manufacturer shall not be liable for the damage if other terminals are used.
- Power off the battery system before connecting the power cable to avoid high voltage danger.
- It is recommended to use a YQK-70 hydraulic plier with an "16" mark on the crimping dies to crimp the DC terminal of the battery.
- If the power terminal needs to be prepared by customers, it is recommended to use RNB 14-5 terminal. If the terminal cannot be purchased, choose the appropriate terminal according to the recommended size.
- If the recommended hydraulic plier cannot be purchased, please choose the crimping tool according to the terminal size to ensure that the crimped terminals meet the usage requirements.
- The PE cable should be prepared by the customer. Type: outdoor PV cables satisfying the inverter's max input voltage.



- **Step 1:** Strip the insulation layer and insert the bared conductor into the terminal.
- **Step 2:** Crimp the Power cable.
- **Step 3:** Install the heat shrink tube.
- **Step 4:** Connecting the Power cable.

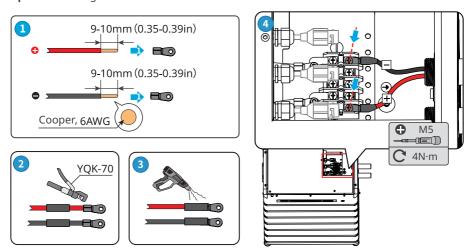

### 6.2.4 Connecting the Communication Cable

#### **NOTICE(AVIS)**

 Please refer to the following pin definitions if you need to make a new battery communication cable.

### **RJ45 Modular Connector**





### **CAN Communication port**

PIN	COM1	COM2	сомз	Description
1	CAN3H	CAN3H	CAN3H	BMS communication for battery
2	CAN3L	CAN3L	CAN3L	system parallel connection
3	N/A	N/A	N/A	Reserved
4	CAN2H	N/A	N/A	COM1: connects to the inverter
5	CAN2L	N/A	N/A	BMS communication port to communication with the inverter COM2, COM3: reserved
6	ISO_GND	ISO_GND	N/A	PIN for grounding.
7	HVIL_IN	HVIL_IN	N/A	COM1, COM2: interlock function
8	HVIL_OUT	HVIL_OUT	N/A	COM3: reserved

# WARNING(AVERTISSEMENT)

- Detailed requirements for communication cable connection and termination resistor installation can be obtained in the system wiring network. This chapter only describes the connection method of communication cables and port definitions.
- If the termination resistor is not installed, the Interlock Failure will occur, and the battery system cannot work correctly.


# **Connecting the Communication Cable**


**Step 1:** Disassemble the waterproof module.

**Step 2:** Route the communication cable through the waterproof module.

**Step 3:** Connect the communication cable to the battery. Tighten the waterproof module.


**Step 4** (**Optional**): Connect the other end of the communication cable to the adapter, which is connected to the inverter.

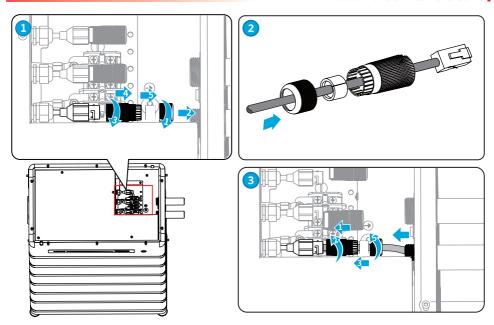

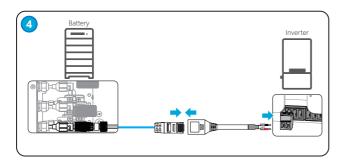


### **Remove the Terminal Resistor**

- **Step 1:** Disassemble the waterproof module.
- **Step 2:** Remove the terminal resistor from the communication port.
- **Step 3:** Tighten the waterproof module.

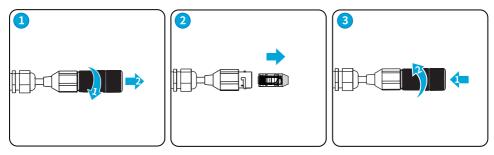


# **Installing the Termination Resistor**

- **Step 1:** Disassemble the waterproof module.
- Step 2: Install the terminal resistor.
- **Step 3:** Tighten the waterproof module.

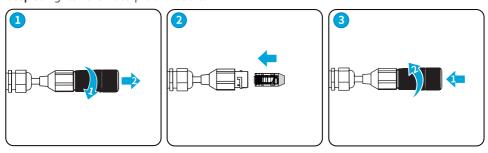

# 6.2.5 Installing the top cover of the PCU

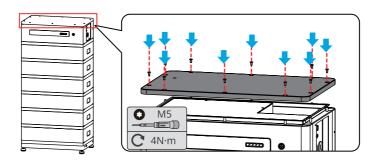

# 07 System Operation

### 7.1 Check Before Power ON

Check the following items before power on to avoid the battery system being damaged.

No.	Check Item
1	The equipment is firmly installed in a clean place where is well-ventilated and easy to operate.
2	The PE cable, power cable, communication cable, and terminal resistor are connected correctly and securely.
3	Cable ties are intact, routed properly and evenly.
4	Unused ports and terminals are sealed.


### 7.2 Power ON the Battery System

#### NOTICE(AVIS)

- The equipment in the dashed boxes are optional.
- Install the circuit breaker between the inverter and the battery and the circuit breaker between the two battery systems in compliance with local laws and regulations.
- Strictly follow the power on requirements to avoid damaging the system.
- To ensure effective protection, the cover of the battery system switch should remain closed.
   The cover can be closed automatically after being opened. Fasten the cover with screws if the switch is not to be used for a long-term period.

#### Method I:

- **Step 1:** Turn on the breaker between the inverter and the battery system.
- Step 2: (Optional) Turn on the breaker between the battery systems if they are clustered.
- **Step 3:** Turn on the battery system switch. Turn on the switches of the battery systems in turn if they are clustered.
- **Step 4:** Turn on the inverter in the system following the instructions in the user manual of the inverter.

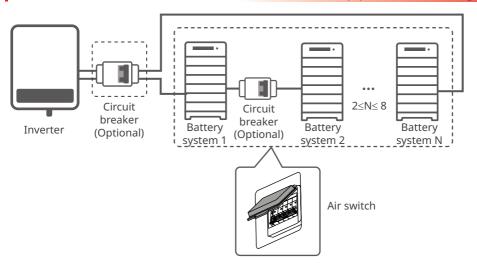

#### **NOTICE(AVIS)**

- When the inverter cannot be started through the DC voltage of the PV string, the battery can be turned on to provide power to the inverter.
- After the battery system is started, set the battery model through SolarGo App within 10 minutes to ensure normal communication between the inverter and the battery.

#### Method II:

**Step 1:** Long press the multi-function button for 5-15s to start the battery system. If it is a parallel battery system, long press the multi-function button of every battery system in sequence.

**Step 2:** Turn on the inverter in the system following the instructions in the user manual of the inverter.


### 7.3 Setting the Battery Parameters

Select battery model via SolarGo after successfully connecting the battery module and the inverter.

APP installation and connection



Set battery model via the SolarGo App.

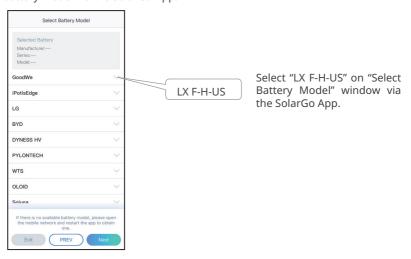

#### NOTICE(AVIS)

"Battery Communication Failure" will be displayed if you select the wrong battery model. Please select the right battery model accordingly.

# 7.4 Indicator Status



Multi-function Button	Status
Green	Standby or Working
Red	Alarming or Faulty

### 7.4.1 Normal Status

Button Indicator	SOC Indicator	Description
		SOC<5%
		5%≤SOC<25%
Idle: green light blink 2 times Standby: green light blink 1 time Working: steady green		25%≤SOC<50%
		50%≤SOC<75%
		75%≤SOC<95%
		SOC≥95%

### NOTICE(AVIS)

- The SOC indicator keeps on when charging.
- The SOC indicator blinks one time when discharging.

# 7.4.2 Alarming Status

Multi- function Button	SOC Indicator	Alarm	Solutions	
Red light blink 2 times		Battery Overvoltage	Restart the battery. Contact the After Sale Service if the problem could not be solved.	
		Battery Undervoltage	Long press the button for 5 seconds to start the battery under charging conditions. Contact the After Sale Service if the problem could not be solved.	
		Overcurrent Charging	Restart the battery. Contact the After Sale Service if the problem could not be solved.	
		Overcurrent Discharging	Restart the battery. Contact the After Sale Service if the problem could not be solved.	
		Temperature Difference Exception	Power off and wait for 2 hours. Contact the After Sale Service if the problem could not be solved.	
		High Temperature	Power off and wait for 2 hours. Contact the After Sale Service if the problem could not be solved.	
		Low Temperature	Power off and wait for 2 hours. Contact the After Sale Service if the problem could not b solved.	
		Interlock Failure	Contact the After Sale Service if the problem could not be solved.	
		Others	Contact the After Sale Service.	

# 7.4.3 Faulty Status

Button Indicator	SOC Indicator	Fault	Solutions
Steady red		Battery Overvoltage	Restart the battery. Contact the After Sale Service if the problem could not be solved.
		Battery Undervoltage	Long press the button for 5 seconds to start the battery under charging conditions. Contact the After Sale Service if the problem could not be solved.
		Overcurrent Charging	Restart the battery. Contact the After Sale Service if the problem could not be solved.
		Overcurrent Discharging	Restart the battery. Contact the After Sale Service if the problem could not be solved.
		Temperature Difference Exception	Power off and wait for 2 hours. Contact the After Sale Service if the problem could not be solved.
		High Temperature	Power off and wait for 2 hours. Contact the After Sale Service if the problem could not be solved.



	Low Temperature	Power off and wait for 2 hours. Contact the After Sale Service if the problem could not be solved.	
Steady red	Inconsistent Software Version	Contact the After Sale Service if the problem could not be solved.	
	Precharge Fault	Restart the battery. Contact the After Sale Service if the problem could not be solved.	
	Relay Fault	Restart the battery. Contact the After Sale Service if the problem could not be solved.	
	Air Switch Fault	Restart the battery. Contact the After Sale Service if the problem could not be solved.	
	Insulation Fault	Do not touch the battery. Contact the After Sale Service.	
	Internal Communication Fault	Power off and check the communication cables. Restart the battery. Contact the After Sale Service if the problem could not be solved.	
	SN Fault	Contact the After Sale Service.	
	Voltage Balance Fault	Restart the battery. Contact the After Sale Service if the problem could not be solved.	
	Inconsistent Master and Slave	Restart the battery. Contact the After Sale Service if the problem could not be solved.	
	Temp. Sensor Fault	Restart the battery. Contact the After Sale Service if the problem could not be solved.	
	Others	Contact the After Sale Service if the problem could not be solved.	

### 08 Maintenance

### 8.1 Power OFF the Battery System

#### DANGER(DANGER)

INSTRUCTIONS PERTAINING TO A RISK OF FIRE OR ELECTRIC SHOCK

- Power off the battery system before operations and maintenance. Otherwise, the equipment may be damaged or electric shocks may occur.
- · Push the air switch to restart the battery.

Follow the steps below to power off the battery system to prevent the system from being damaged.

#### Method one:

**Step 1:** Turn off the inverter in the system following the instructions in the user manual of the inverter.

**Step 2:** Long press the multifunction Multi-function button for more than 15s, and make sure that the SOC indicator and the Multi-function button of the PCU are off.

#### Method two:

**Step 1:** Turn off the inverter in the system following the instructions in the user manual of the inverter.

**Step 2:** Disconnect the air switch, and make sure that the SOC indicator and the Multi-function button of the PCU are off.

### 8.2 Routine Maintenance

### ⚠ WARNING(AVERTISSEMENT)

- Contact the after-sales service for help if you find any problems that may influence the battery or the hybrid inverter. Disassemble without permission is strictly forbidden.
- Contact after-sale service for help if the copper conductor is exposed. Do not touch or disassemble privately because the high voltage danger exists.
- In case of other emergencies, contact the after-sales service as soon as possible. Operate following the instructions or wait for the after-sales service personnel.
- En cas de problème susceptible d'affecter le système de batterie ou l'onduleur de stockage, veuillez contacter le service après-vente. Il est strictement interdit de procéder à un démontage sans autorisation.
- Si des fils de cuivre internes du conducteur électrique sont exposés, ne les touchez pas (danger de haute tension), contactez le service après-vente et ne procédez pas à un démontage sans autorisation.
- En cas d'autres situations d'urgence, contactez immédiatement le service après-vente et suivez ses instructions ou attendez l'intervention sur place du personnel après-vente.

Maintaining Item	Maintaining Period	
Checkwhether the locking bracket is secured, tighten it if not.	Once every 6 months	
Check whether the outer enclosure is broken. Repair the painting or contact the after-sales service if there is any broken.	Once every 6 months	
Check whether there is an exposed cable. Replace the exposed cable or contact the after-sales service for help.	Once every 6 months	
Check whether there is any dust around the battery module. Clean the dust if there is any to avoid affecting heat dissipation.	Once every 6 months	
Check whether there is any liquid or pest near the battery to avoid intrusion in a long term.	Once every 6 months	

# 8.3 Recycling and Disposal

It is forbidden to dispose of used batteries at will, and the disposaI of used batteries shall comply with the laws and regulations of each federation.

#### 09 **Parameters**

Technical	Parameters	LX F9.6-30	LX F12.8-30	LX F16.0-30	LX F19.2-30	
Usable Energy (kWh)*		9.6	12.8	16.0	19.2	
Battery Module		LX F3.2-30: 64V 50Ah 3.2 kWh				
Number of Modules		3	4	5	6	
Cell Type		LFP(LiFePO4)				
Cell Configuration		60S1P	80S1P	100S1P	120S1P	
Nominal Voltage (V)		192	256	320	384	
Operating Voltage Range (V)		171~216	228~288	285~360	342~432	
Nominal Dis-/Charge Current (A)*2		35				
Nominal	Power(kW)*	6.72	8.96	11.2	13.44	
Short-Circuit Current		4.2kA 1.0ms	4.6kA 1.0ms	4.7kA 1.0ms	4.9kA 1.0ms	
Operating Temperature Range (°F)		Charge: +32~+122; Discharge: +5~+122				
Relative Humidity		≤95%				
Altitude (Ft)		≤9842				
Communication		CAN				
Weight (lb)		300.9	384.7	468.5	552.3	
Dimensions (W×H×D in)		23.6*15*29.5	23.6*15*35.6	23.6*15*41.7	23.6*15*47.8	
Ingress Protection Rating		IP55				
Storage Temperature (°F)		-4~+131				
Mounting Method		Ground-Mounted				
Round-trip Efficiency		95.98%				
Cycle Life		3500@77°F				
Standard and Certification	Safety	UL1973-2018, UL9540A-2019				
	ЕМС	FCC part 15				
	Transportation	UN38.3				

<sup>\*1:</sup> Test conditions, 100% DOD, 0.2C charge & discharge at 77±2°F for battery system at beginning life. System Usable Energy may vary with different Inverter.
\*2: Nominal Dis-/Charge Current and power derating will occur related to Temperature and

<sup>\*3:</sup> Based on 2.5~3.65V voltage rang @77±2°F of Cell under 1C/1C test condition and 80% EOL.





Official Website

SolarGo App

# GoodWe Technologies Co.,Ltd.



No. 90 Zijin Rd., New District, Suzhou, 215011, China



www.goodwe.com



